

C.I.P.**256 Win. Mag.**

TAB.

II


Date

84-06-14

Révision

02-05-15

Pays d'origine: US

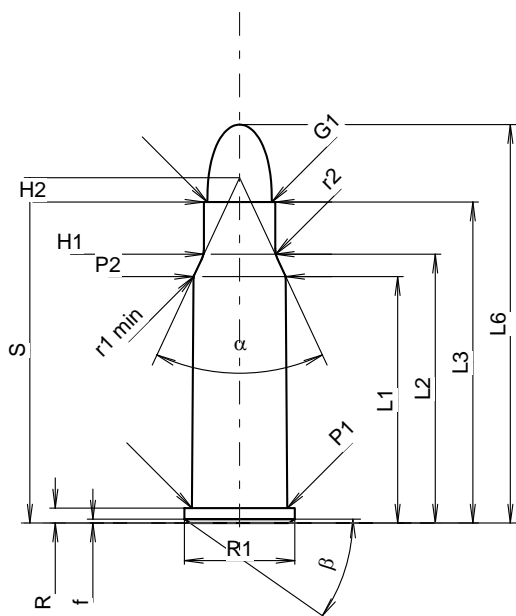**CARTOUCHE MAXI****Longueurs**

L1	=	24.98
L2	=	27.25
L3 ¹⁾	=	32.54
L4	=	
L5	=	
L6	=	40.39

Culot

R ¹⁾	=	1.52	-0.25
R1	=	11.18	
R3	=		
E	=		
E1	=		
e min	=		
delta	=		
f	=	0.40	
beta	=	35°	

Chambre à poudre

P1	=	9.68
P2 *	=	9.35

Cône de raccordement

alpha *	=	50°
S *	=	35.01
r1 min	=	0.76
r2	=	2.54

Collet

H1 *	=	7.24
H2 ¹⁾	=	7.24

Projectile

G1 ¹⁾	=	6.53
G2	=	
F	=	
L3+G ¹⁾	=	35.52

Pressions (Énergies)**Méthode transducteur**

Pmax	=	3500 bar
PK	=	4025 bar
PE	=	4375 bar
M	=	17.50
EE	=	1365 Joule

Autres indications

Fe ¹⁾	=	0.15
delta L	=	

CHAMBRE MINI**Longueurs**

L1	=	25.11
L2	=	27.34
L3 ¹⁾	=	32.82

Cuvette

R ¹⁾	=	1.55
R1	=	11.43
R2	=	
R3	=	
r	=	

Chambre à poudre

E	=	
P1 ¹⁾	=	9.70
P2 *	=	9.37

Cône de raccordement

alpha *	=	50°
S *	=	35.16
r1 max	=	0.76
r2	=	2.54

Collet

H1 *	=	7.29
H2 ¹⁾	=	7.26

Prise de rayures


G1 ¹⁾ *	=	6.63
G ¹⁾	=	2.99
alpha 1 *	=	90°
h	=	0.32
s	=	
i ¹⁾ *	=	3°
w	=	

Canon

F ¹⁾ *	=	6.35
Z ¹⁾	=	6.50

Rayures

b	=	2.01
N	=	6
u	=	356.00
Q	=	32.59 mm ²

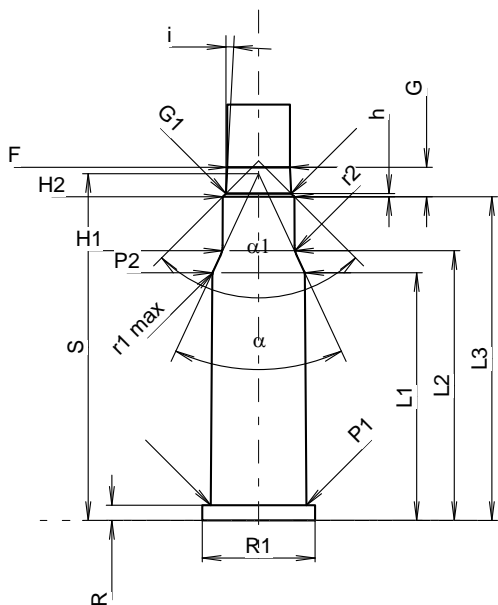

Échelle 1.31:1

Dimensions en << mm >>
Dimensions et tolérances pour les canons
d'épreuve: Voyez Annexe CR 1.

Notes: 1) A' contrôler pour la sécurité
* Dimensions de base