


C.I.P.**264 Win. Mag.**

TAB. III

Date 84-06-14

Pays d'origine: US

Révision 02-05-15

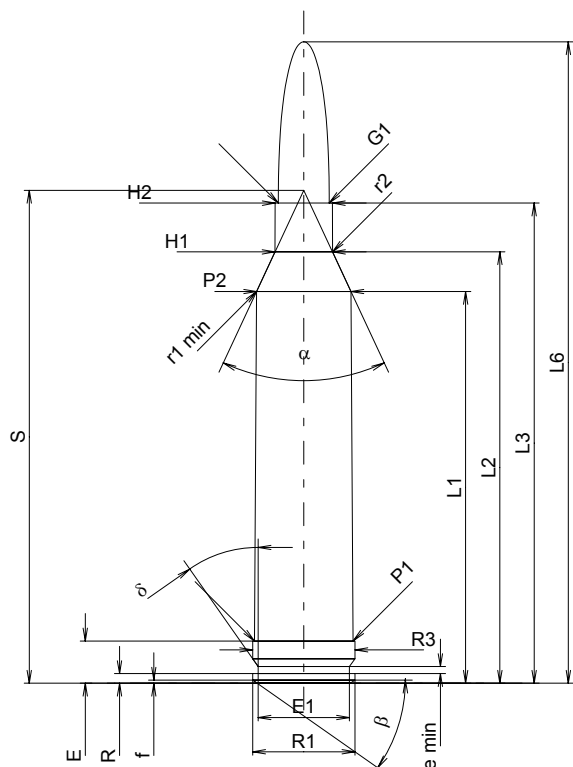**CARTOUCHE MAXI****Longueurs**

L1	=	51.82
L2	=	57.05
L3 ¹⁾	=	63.50
L4	=	
L5	=	
L6	=	84.84

Culot

R	=	1.27
R1	=	13.51
R3	=	13.51
E ¹⁾	=	5.59
E1	=	12.07
e min	=	0.94
delta	=	35°
f	=	0.41
beta	=	35°

Chambre à poudre

P1	=	13.03
P2*	=	12.47

Cône de raccordement

alpha*	=	50°
S*	=	65.19
r1 min	=	3.30
r2	=	3.84

Collet

H1*	=	7.59
H2 ¹⁾	=	7.57

Projectile

G1 ¹⁾	=	6.73
G2	=	
F	=	
L3+G ¹⁾	=	68.35

Pressions (Énergies)**Méthode transducteur**

Pmax	=	4300 bar
PK	=	4945 bar
PE	=	5375 bar
M	=	25.00
EE	=	4095 Joule

Autres indications

Fe ¹⁾	=	0.10
delta L	=	

CHAMBRE MINI**Longueurs**

L1	=	49.02
L2	=	57.21
L3 ¹⁾	=	64.11

Cuvette

R	=	
R1	=	13.59
R2	=	
R3	=	13.59
r	=	

Chambre à poudre

E ¹⁾	=	5.59
P1 ¹⁾	=	13.06
P2*	=	12.50

Cône de raccordement

alpha*	=	50°
S*	=	65.42
r1 max	=	0.76
r2	=	3.81

Collet

H1*	=	7.66
H2 ¹⁾	=	7.62

Prise de rayures


G1 ^{1)*}	=	6.81
G ¹⁾	=	4.85
alpha1*	=	90°
h	=	0.41
s	=	
i ^{1)*}	=	2°
w	=	

Canon

F ^{1)*}	=	6.50
Z ¹⁾	=	6.71

Rayures

b	=	2.29
N	=	6
u	=	229.00
Q	=	34.66 mm ²

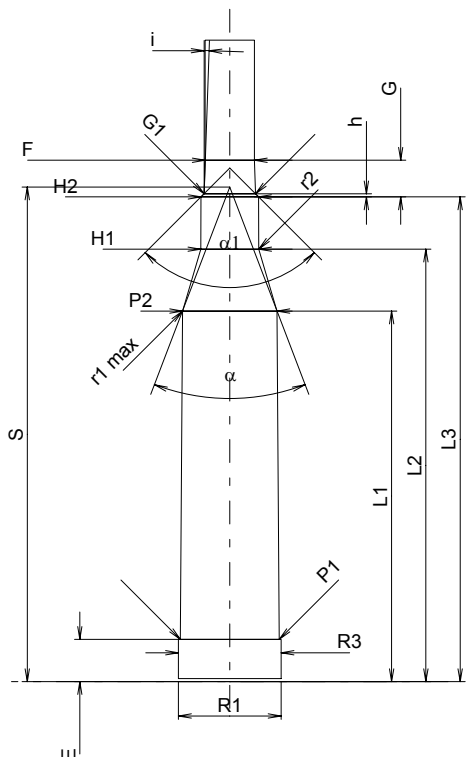

Échelle 1:1

Dimensions en << mm >>
Dimensions et tolérances pour les canons
d'épreuve: Voyez Annexe CR 1.

Notes: 1) A' contrôler pour la sécurité
* Dimensions de base