



C.I.P.	12/50 SAPL	TAB.	X
		Date	84-06-14
		Revision	18-10-17

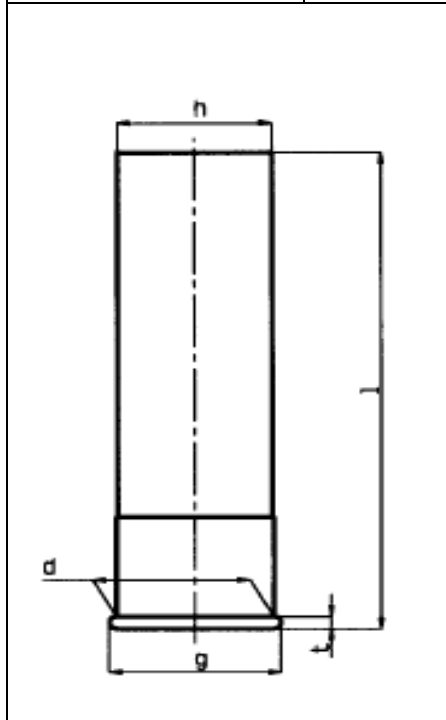

CARTIDGE MAXIMALE

Dimens. Value Toler.

- d¹⁾ = 20.60 - 0.28
- g = 22.45 - 0.48
- t¹⁾ = 1.85 - 0.30
- h = 20.20 - 0.47
- l = 48.60 - 2.50

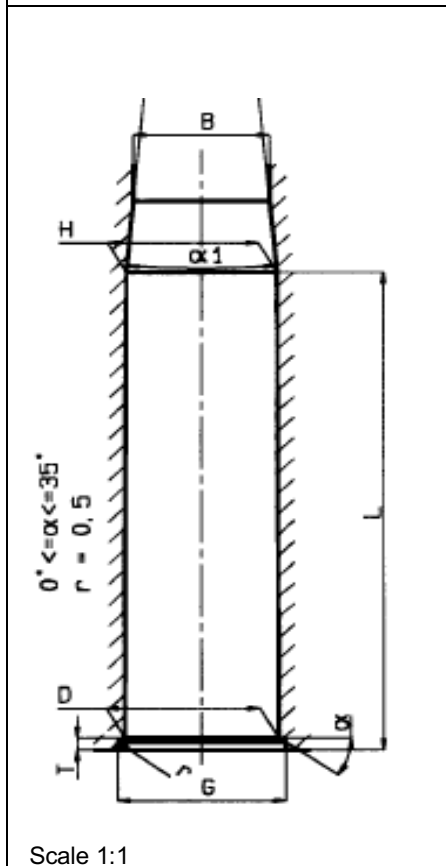

CHAMBER MINIMALE

Dimens. Value Toler.

- D¹⁾ = 20.65 + 0.10
- G = 22.55 + 0.10
- T¹⁾ = 1.85 + 0.10
- H¹⁾ = 20.30 + 0.10
- B¹⁾ = 18.20 + 0.70
- α¹⁾ = 45 ° max
- L¹⁾ = 48.70 + 2.00

Pressure transducer			
Pmax	PK	PE	M
	bar		
90	104	113	25/30

Headspace

- Fe = 0.10
- Fe¹⁾ = 0.20
- Fe¹⁾ = 0.35

Proof Barrel
with bascule
automatic

Scale 1:1

Dimensions in « mm »
Dimensions and tolerances for Proof Barrels :
See Appendix CR 4.

Notes : 1) Check for safety reasons